



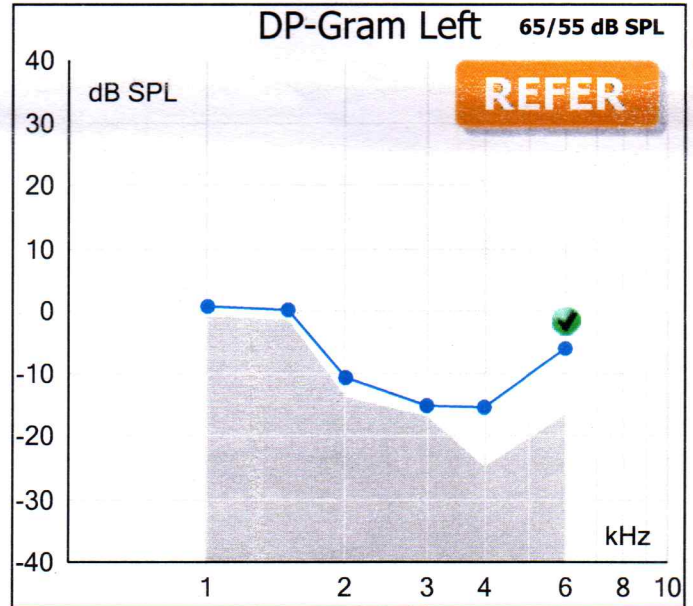

Person ID 02122104
First name Mohammad
Last name Nihan
Birth date 11/7/2020

Gender Male
Mobile

DPOAE 12/2/2021

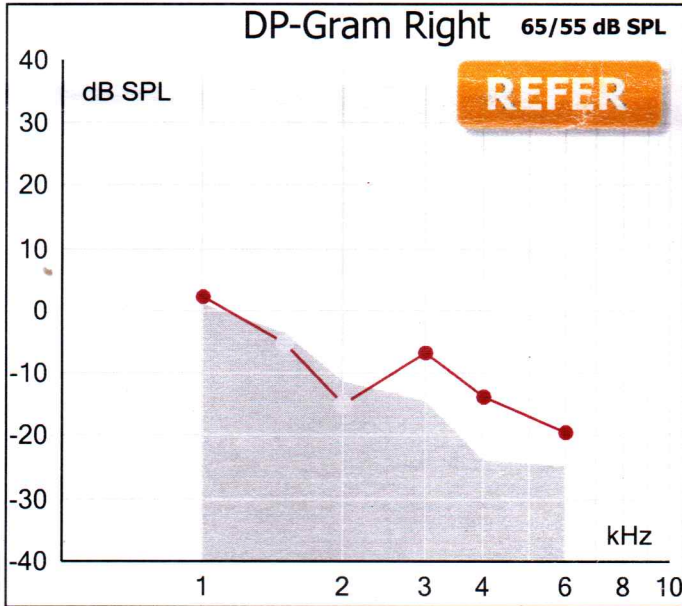

Point summary Right

F2	f2/f1 ratio	DP level	Noise	SNR	Time	Min. reliability	Reliability [%]	Time [s]	MEP	Detected
	1.22				0:30	98%				
1000	1.22	2.2	1	1.2	0:30	98%	59	3.5	MEP	Detected
1500	1.22	-5.3	-3.6	-1.7	0:30	98%	35	3.5	MEP	Detected
2000	1.22	-15.1	-11.5	-3.7	0:30	98%	25	3.5	MEP	Detected
3000	1.22	-6.9	-14.5	7.7	0:30	98%	99	3.5	MEP	Detected
4000	1.22	-13.9	-23.9	10	0:30	98%	100	7.1	MEP	Detected
6000	1.22	-19.5	-24.8	5.3	0:30	98%	95	7	MEP	Detected

Point summary Left

F2	f2/f1 ratio	DP level	Noise	SNR	Time	Min. reliability	Reliability [%]	Time [s]	MEP	Detected
	1.22				0:30	98%				
1000	1.22	0.8	-0.9	1.7	0:30	98%	65	3.5	MEP	Detected
1500	1.22	0.2	-1.4	1.6	0:30	98%	63	3.5	MEP	Detected
2000	1.22	-10.7	-13.8	3.1	0:30	98%	82	5.3	MEP	Detected
3000	1.22	-15.1	-16.9	1.8	0:30	98%	63	7.1	MEP	Detected
4000	1.22	-15.4	-24.8	9.4	0:30	98%	100	7.1	MEP	Detected
6000	1.22	-6.1	-16.6	10.6	0:30	98%	100	1.9	MEP	Detected

DPOAE's Report:

Bilateral DPOAE's REFER (On Repeated Trials) indicative of Abnormal Outer Hair Cell Functioning up to Periphery and Hearing Level may be more than 45 to 50dB Bilaterally.

02/12/21
JESMIN ARA
 Audiologist
 Dept. of Otolaryngology, Head & Neck Surgery
 Bangladesh Sheikh Mujibur Rahman Medical University
Interacoustics
 info@interacoustics.com/+8801730070457